


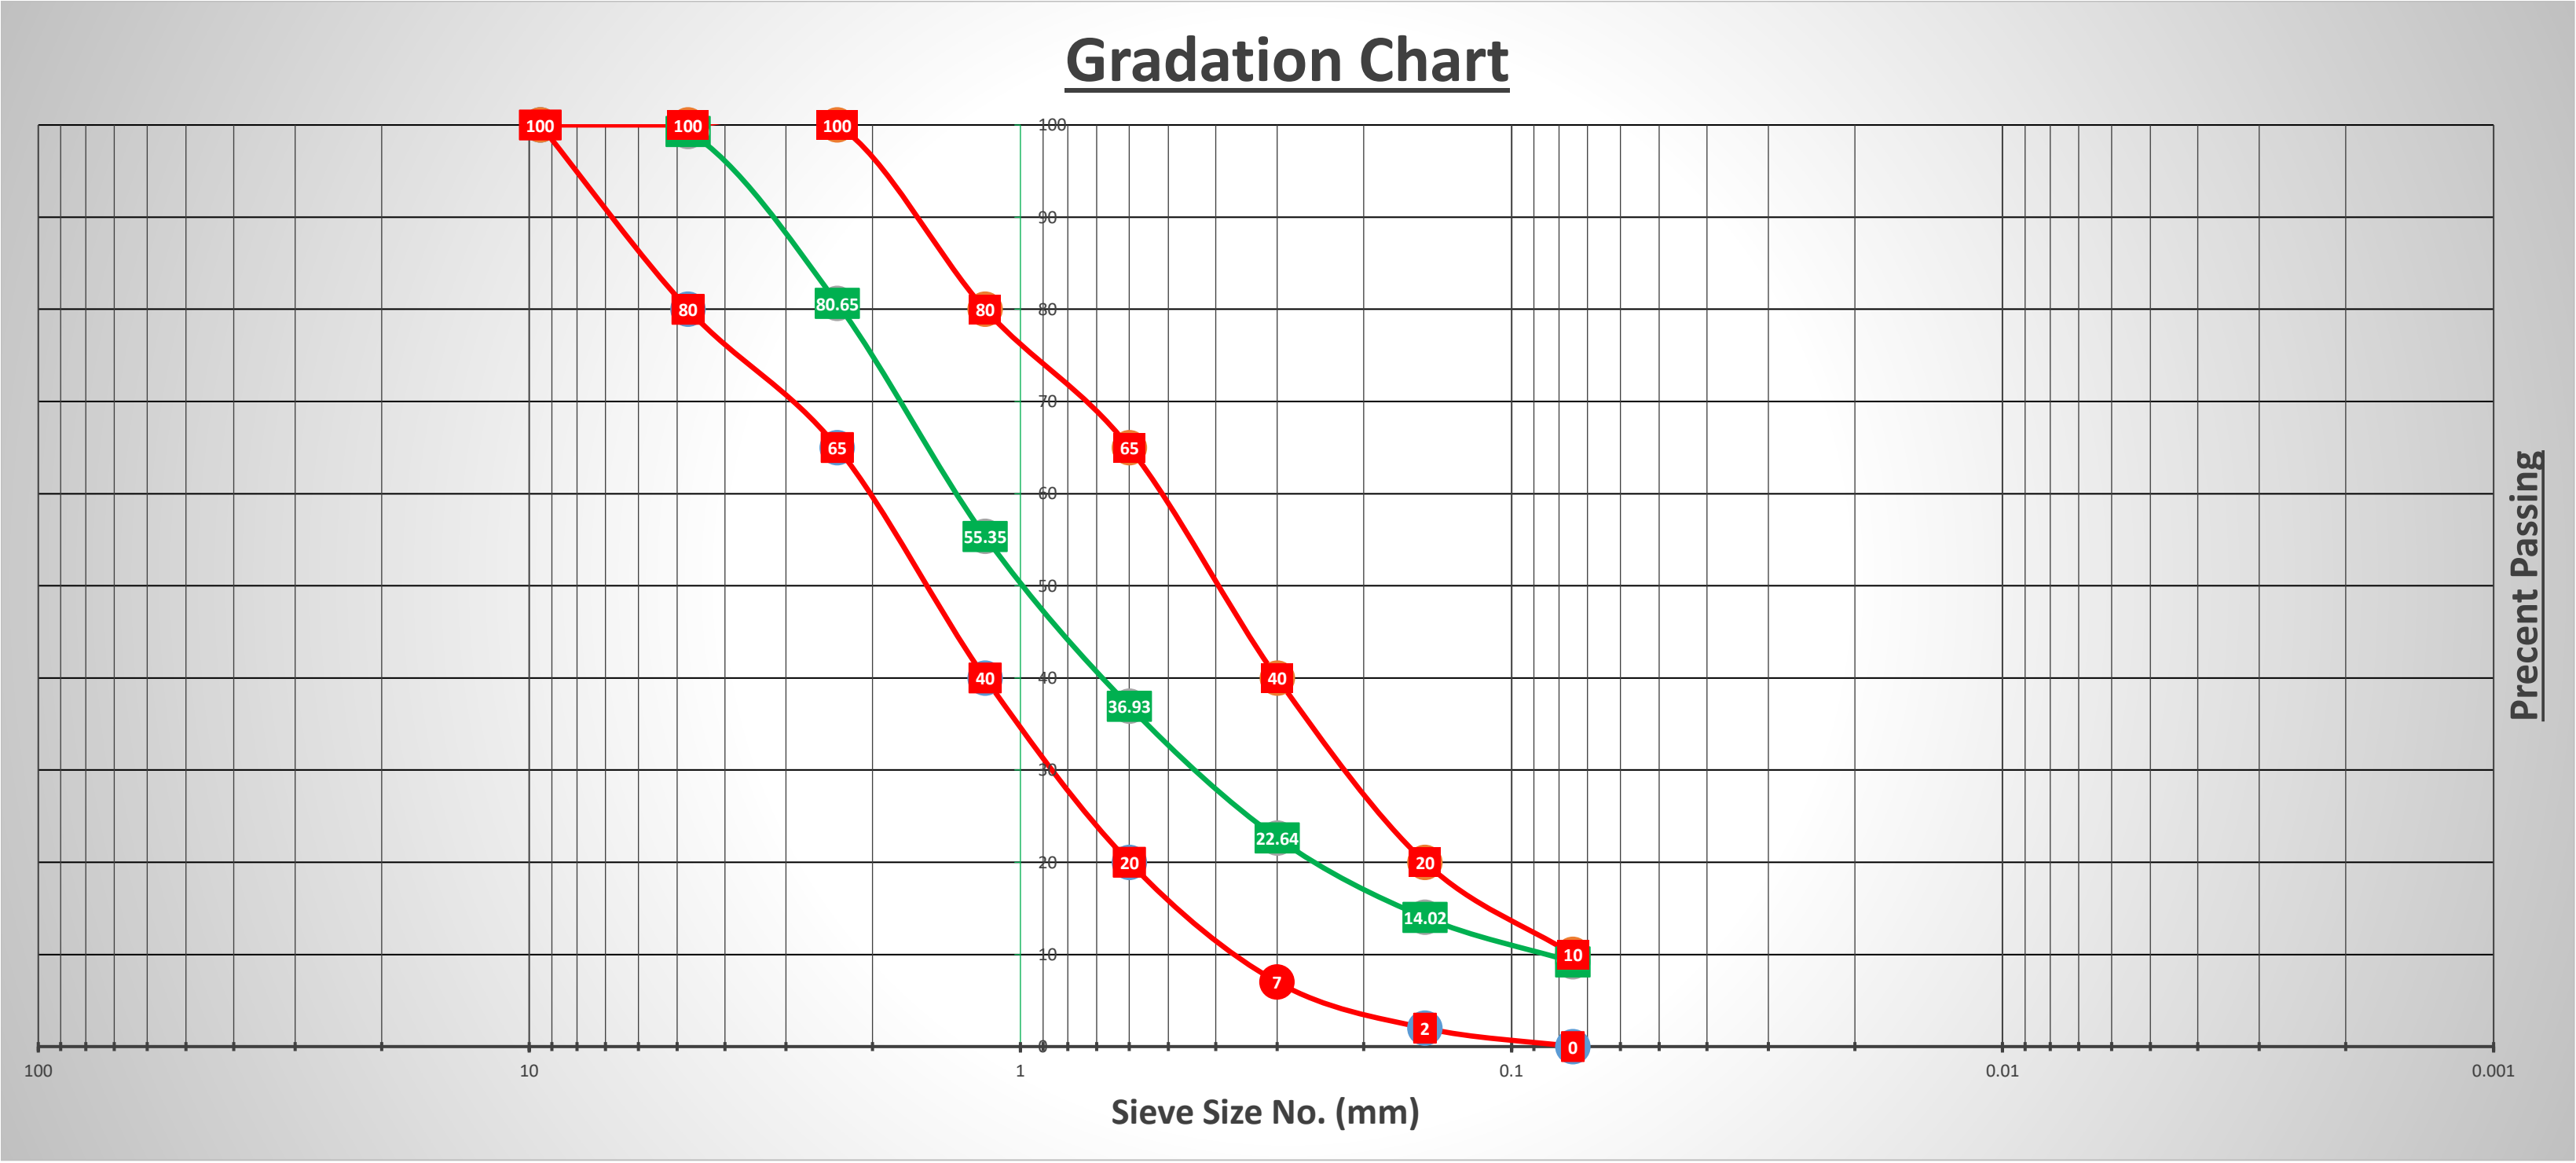

<u>Sieve Size</u>	<u>Mass Retained (g)</u>	<u>Percent Passing</u>	<u>Specification Standards</u>	<u>Specification Standards</u>	<u>Passes / Fails?</u>
3/8"	0.0	100.00	100	100	Passes
No. 4	10.6	99.30	80	100	Passes
No. 8	280.7	80.65	65	100	Passes
No. 16	380.8	55.35	40	80	Passes
No. 30	277.3	36.93	20	65	Passes
No. 50	215.0	22.64	7	40	Passes
No. 100	129.8	14.02	2	20	Passes
No. 200	72.7	9.19	0	10	Passes
On Pan	138.3				